



Does My Farm Need a SPCC Plan?

California APSA

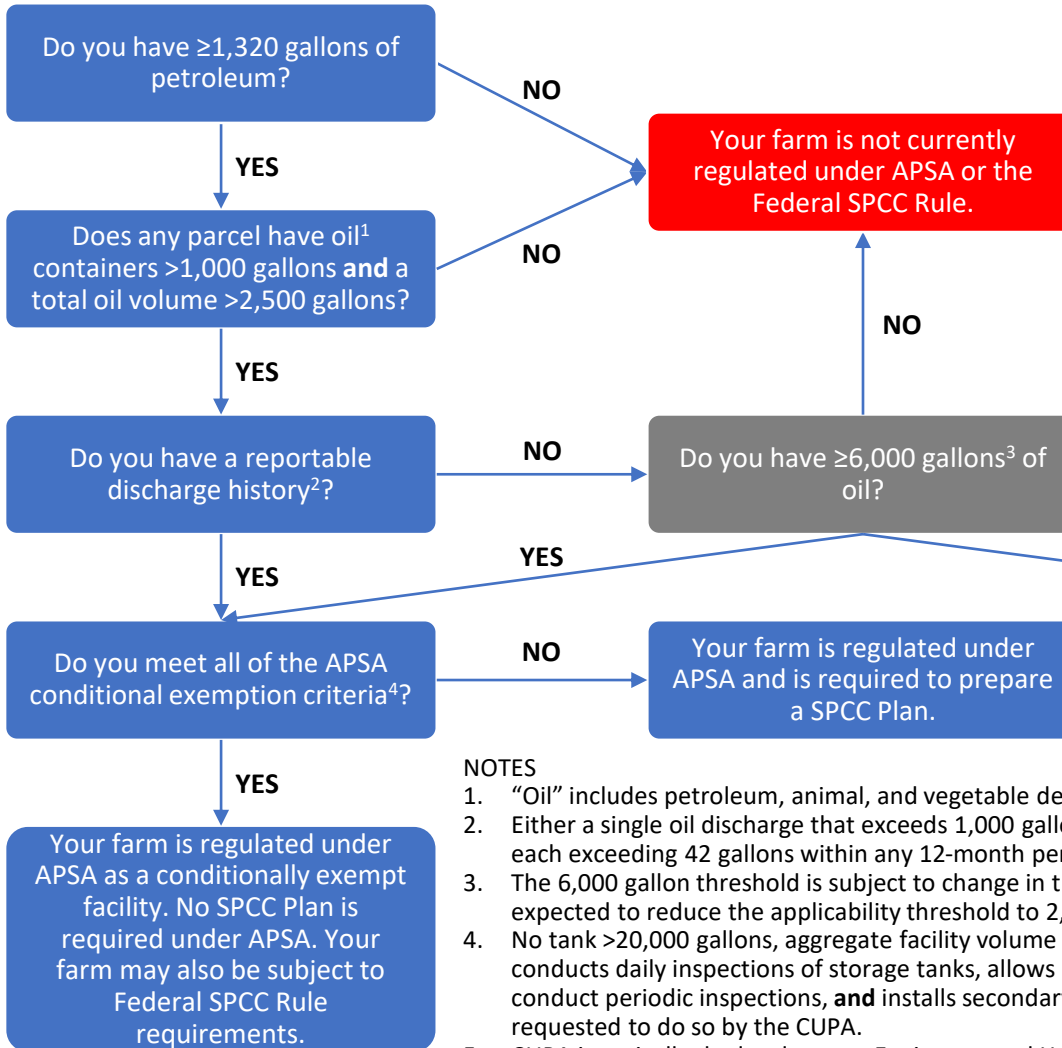

Federal SPCC Rule

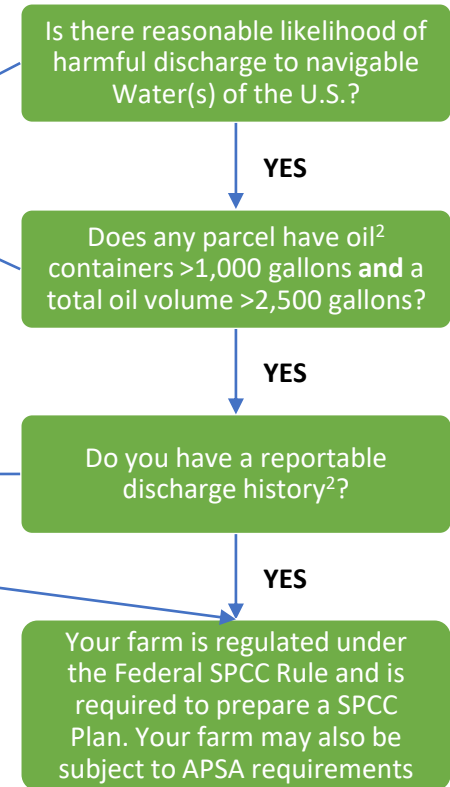

NOTES

1. "Oil" includes petroleum, animal, and vegetable derived oils.
2. Either a single oil discharge that exceeds 1,000 gallons, or 2 oil discharges, each exceeding 42 gallons within any 12-month period.
3. The 6,000 gallon threshold is subject to change in the future. The EPA is expected to reduce the applicability threshold to 2,500 gallons.
4. No tank >20,000 gallons, aggregate facility volume ≤100,000 gallons, conducts daily inspections of storage tanks, allows CUPA inspectors to conduct periodic inspections, and installs secondary containment if requested to do so by the CUPA.
5. CUPA is typically the local county Environmental Health Department

QUESTIONS?

Mike Blankinship
 mike@h2osci.com
 or
 Kenny Tanaka
 kenny@h2osci.com
 (530) 757-0941